


Saddle Connection HPSC (High Performance Soakaway Conduit)

A saddle can be connected to either the side or end of a HPSC to provide easy connection to standard 110mm dia or 160mm diameter underground UPVC push fit pipes by following the sequence of operations as shown below.

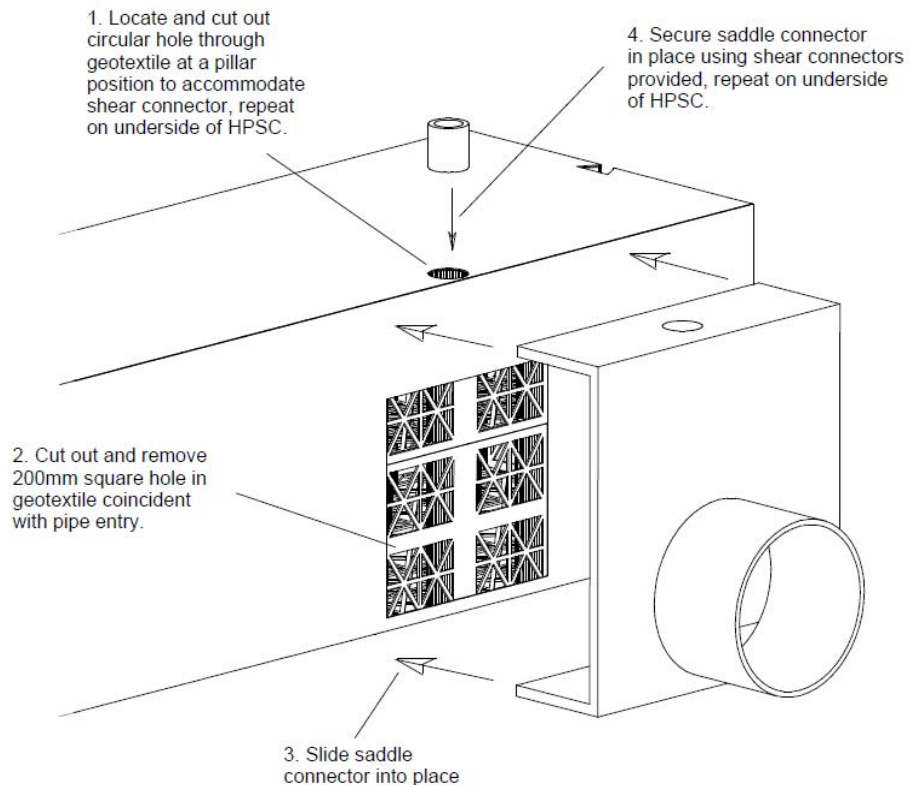

NOTE: The geotextile **MUST** be removed in the location of the pipe stub on the saddle otherwise flow into the system will be severely restricted leading to hydraulic failure of the system.

Disclaimer

This product specification is neither giving nor implying warranty for the use of this information for design and installation, as these are beyond our control. The data provided is typical and based upon the mean values obtained from the samples taken for any one test. If not otherwise indicated the test procedures reflect usually the mean of five samples. Skeletank Limited reserve the right to change the specifications without prior notice. Skeletank[®] is a trade mark registered by Skeletank Limited.

Skeletank Limited,
Stormer Hill Works, Tottington,
Bury, Lancashire
BL8 4AT

Telephone: 0845 177 1535
Fax: 01204 885533
E-Mail: sales@skeletank.co.uk
Web: www.skeletank.co.uk